


# FIGURE 17

## NETWORK INTERFACE DEVICE (NID) INSTALLATION ELECTRIC SERVICE EQUIPMENT WITHIN 35 FEET (10.7 METERS) OF MOBILE HOME

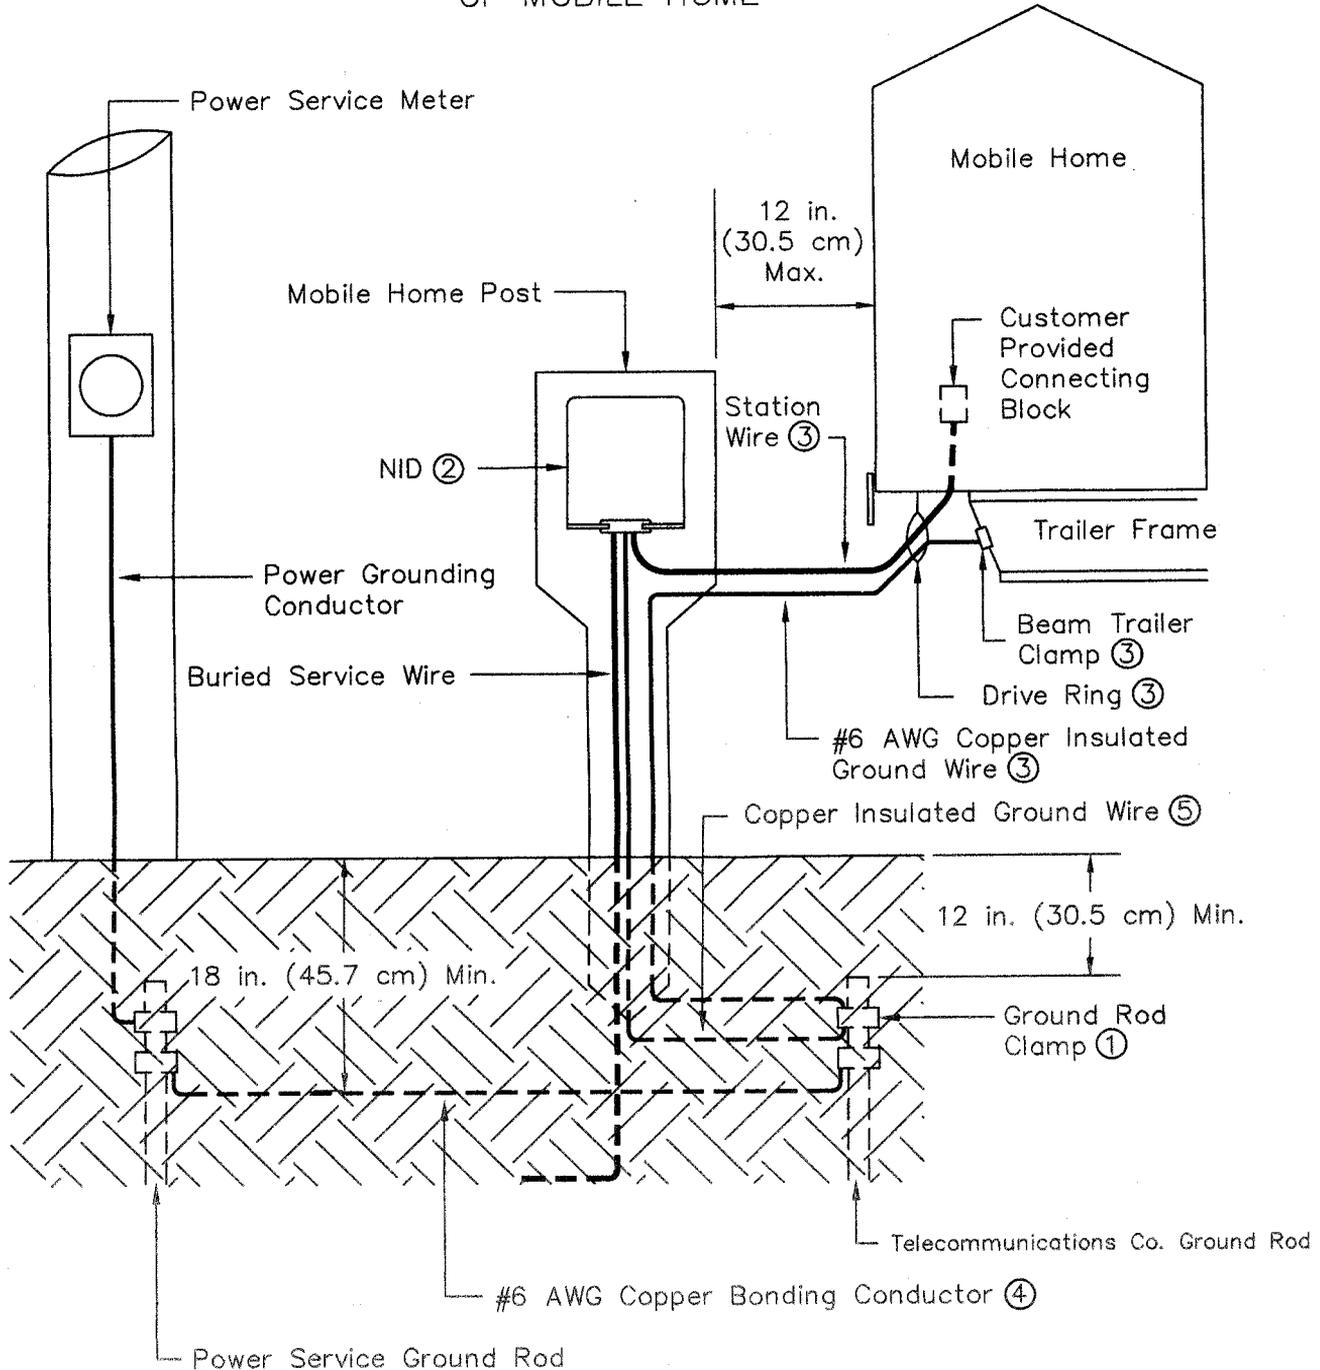

- Notes:
- ① Clamp must be accepted by Listing Agency (UL, etc.) for two conductors, otherwise two clamps must be used.
  - ② See Figure 19 of paragraph (e) of this section for NID terminations. ③ See Figure 20 of paragraph (e) of this section for mobile home installation. ④ Bare if buried its entire length; insulated where human contact is possible. ⑤ See Section 1755.508, paragraph (v), Table 5 for the correct conductor size of the ground wire.