


FIGURE 18

NETWORK INTERFACE DEVICE (NID) INSTALLATION ELECTRIC SERVICE EQUIPMENT MORE THAN 35 FEET (10.7 METERS) FROM MOBILE HOME

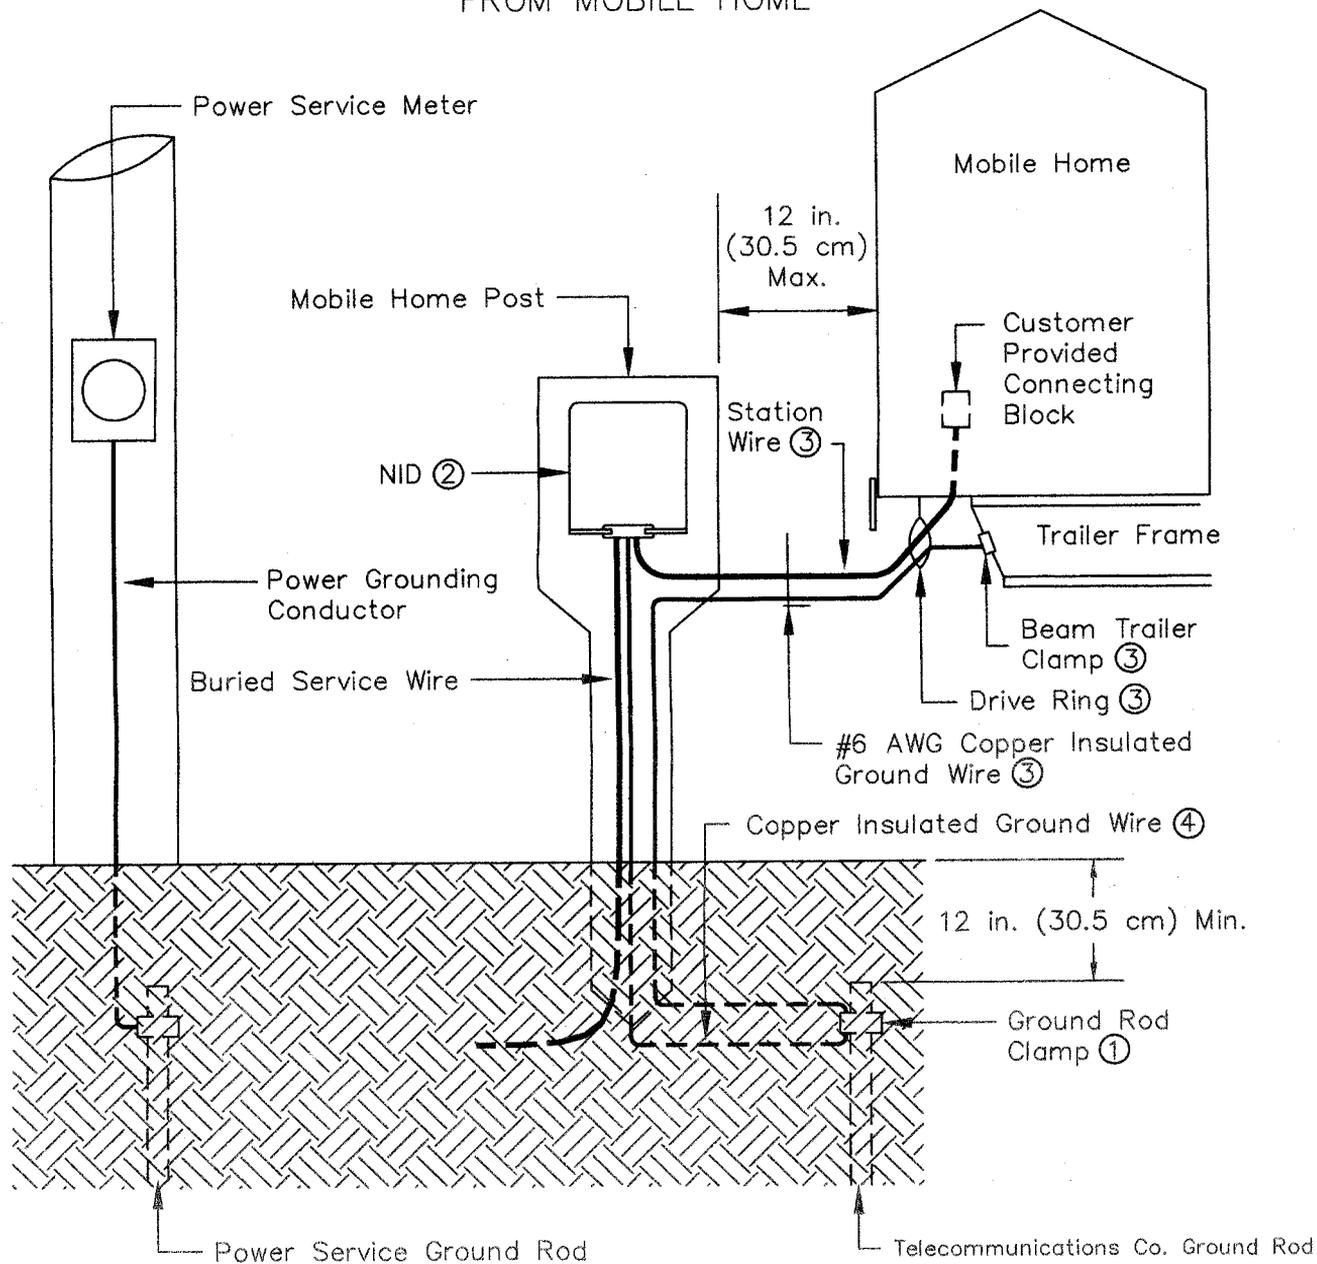

Notes: ①. Clamp must be accepted by Listing Agency (UL, etc.) for two conductors, otherwise two clamps must be used. ②. See Figure 19 of paragraph (e) of this section for NID terminations. ③. See Figure 20 of paragraph (e) of this section for mobile home installation. ④. See Section 1755.508, paragraph (v), Table for the correct conductor size of the ground wire.