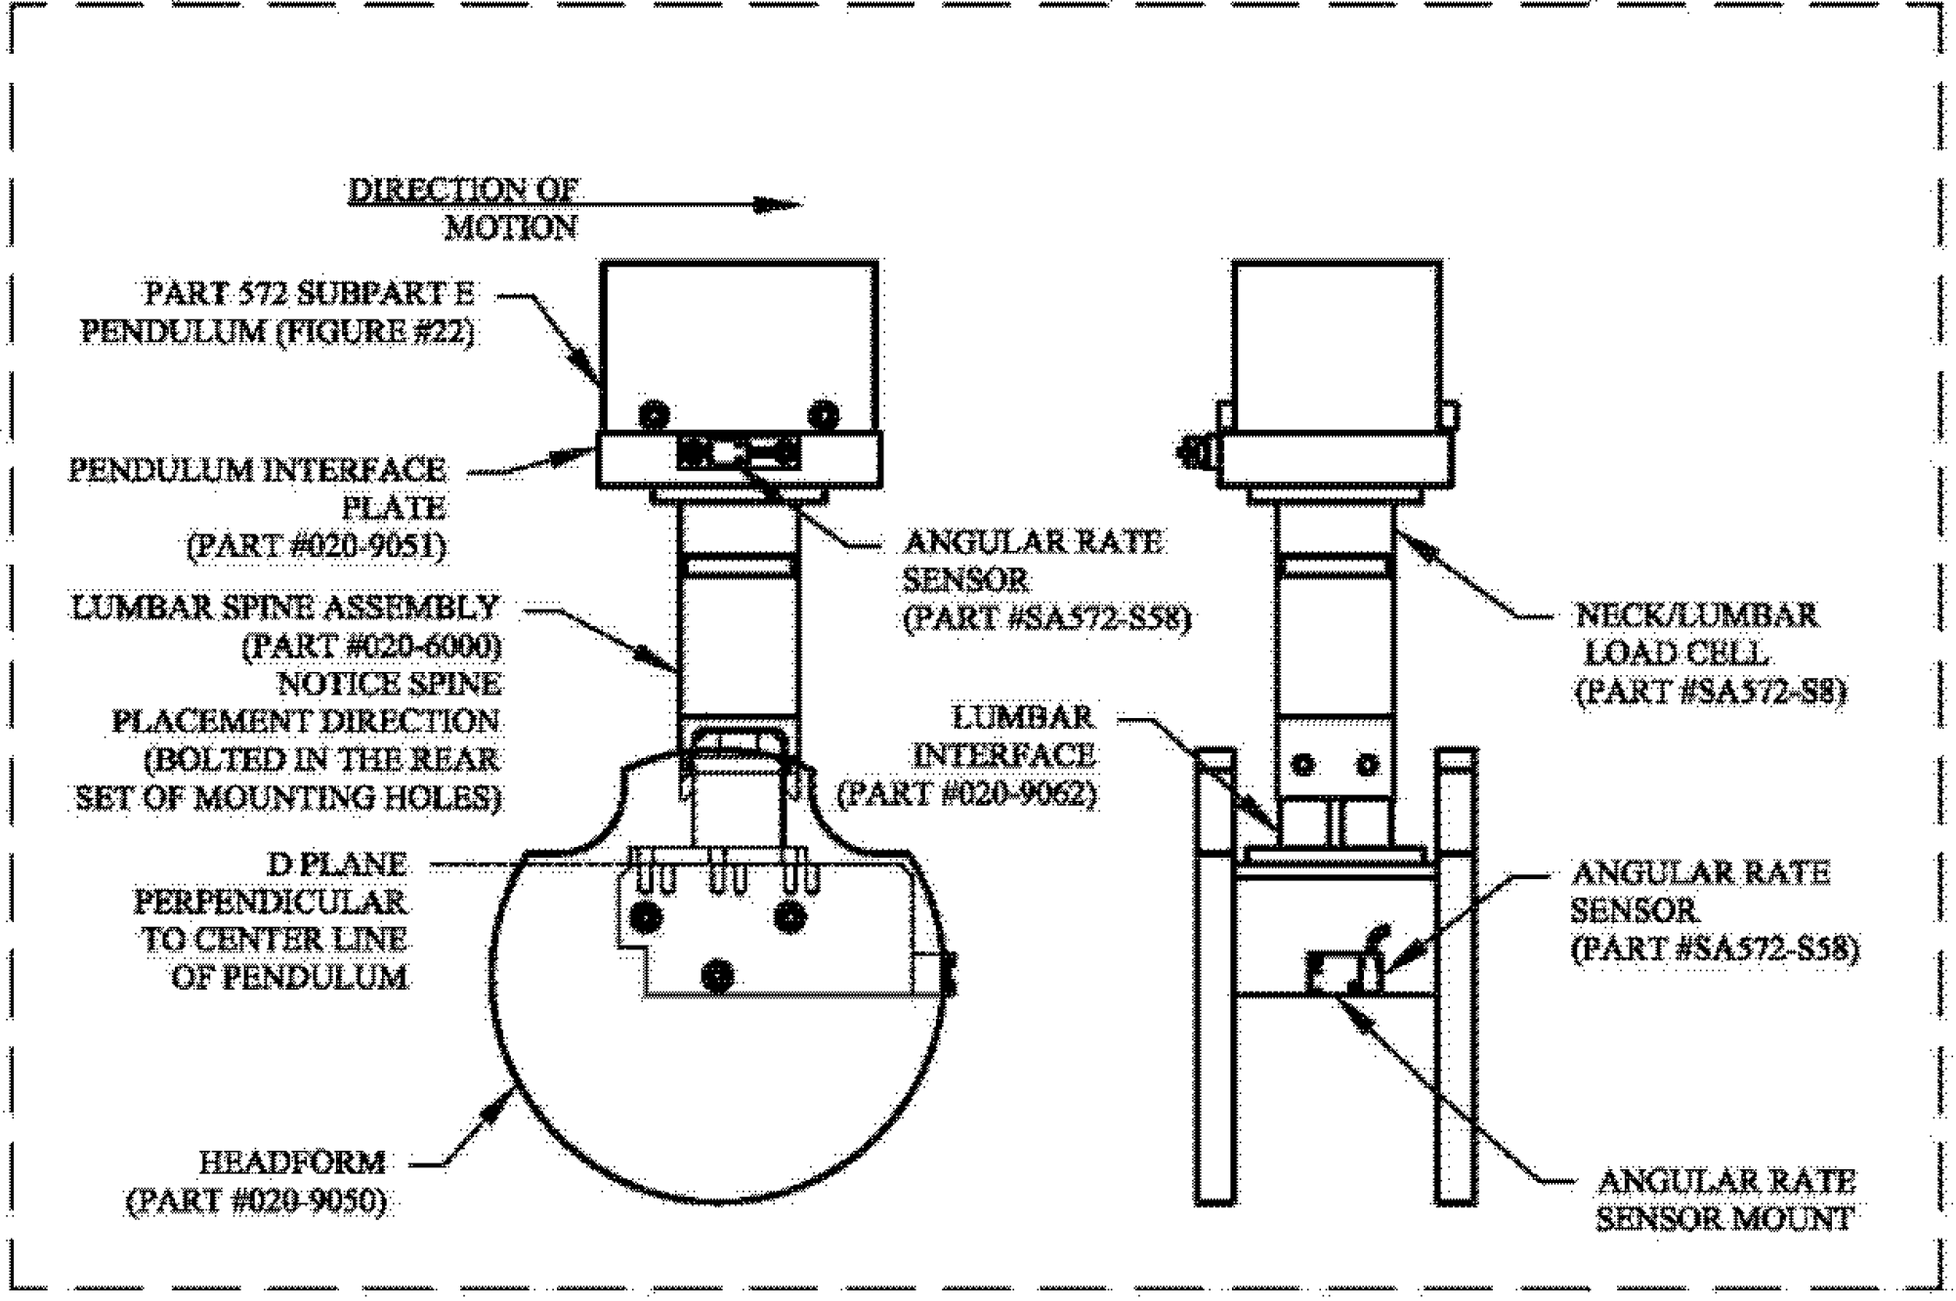

Figure W9. Lumbar frontal flexion test set-up specifications.