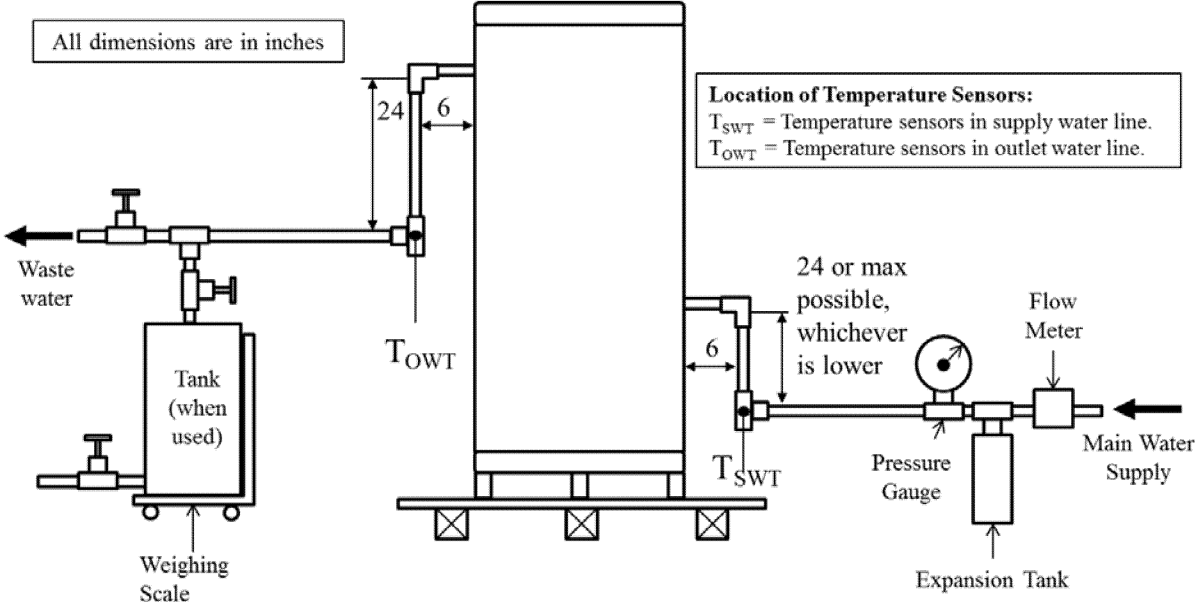

Figure 2.3. Set-up for thermal efficiency and standby loss test for water heaters equipped with horizontal connections