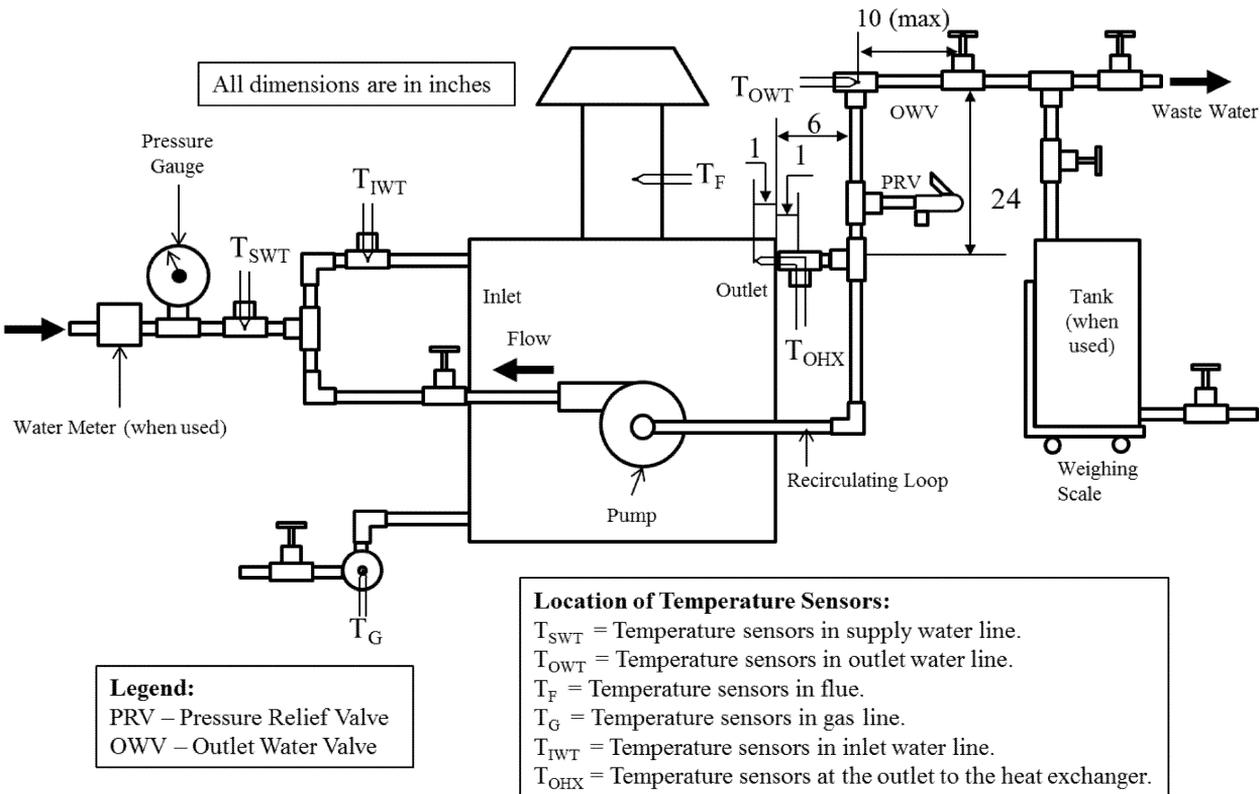


**Figure 2.3. Set-up for thermal efficiency and standby loss test for gas-fired and oil-fired instantaneous water heaters and hot water supply boilers (other than storage-type instantaneous water heaters) equipped with horizontal connections not requiring a recirculating loop.**



**Figure 2.4. Set-up for thermal efficiency and standby loss test for gas-fired and oil-fired instantaneous water heaters and hot water supply boilers (other than storage-type instantaneous water heaters) requiring a recirculating loop for testing.**