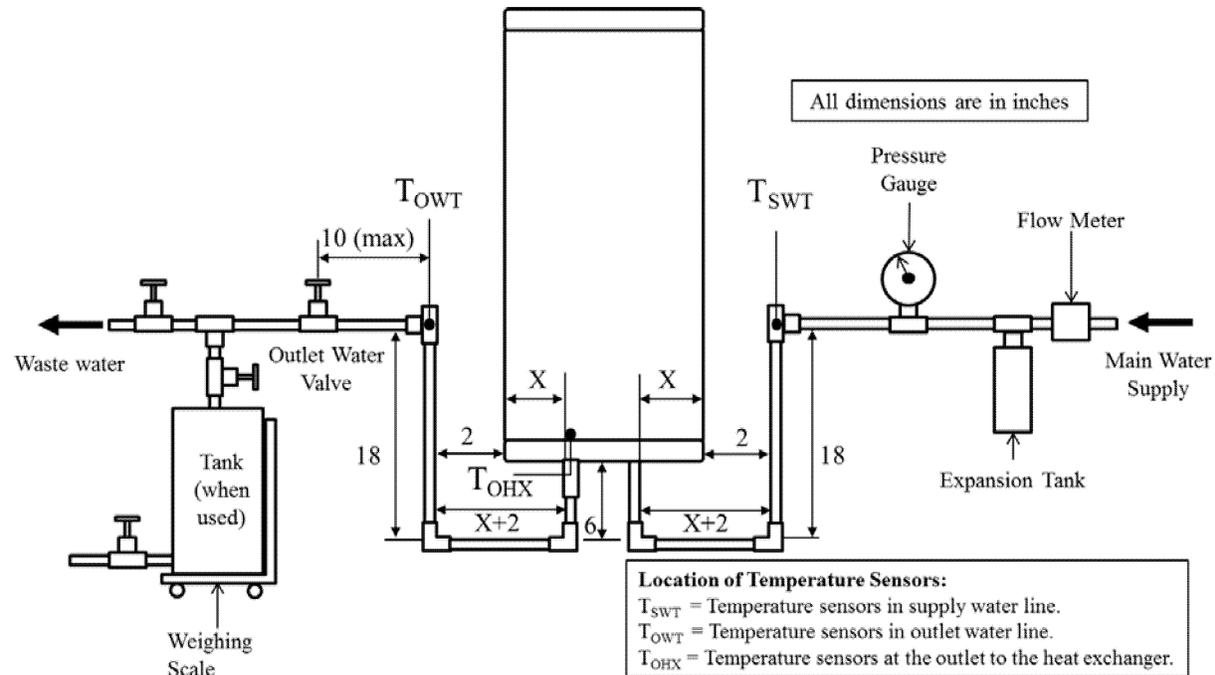


**Figure 2.1.** Set-up for standby loss test for electric instantaneous water heaters (other than storage-type instantaneous water heaters) equipped with vertical (top) connections not requiring a recirculating loop.



**Figure 2.2.** Set-up for standby loss test for electric instantaneous water heaters (other than storage-type instantaneous water heaters) equipped with vertical (bottom) connections not requiring a recirculating loop.