

Figure 2.3. Set-up for standby loss test for electric instantaneous water heaters (other than storage-type instantaneous water heaters) equipped with horizontal connections not requiring a recirculating loop.

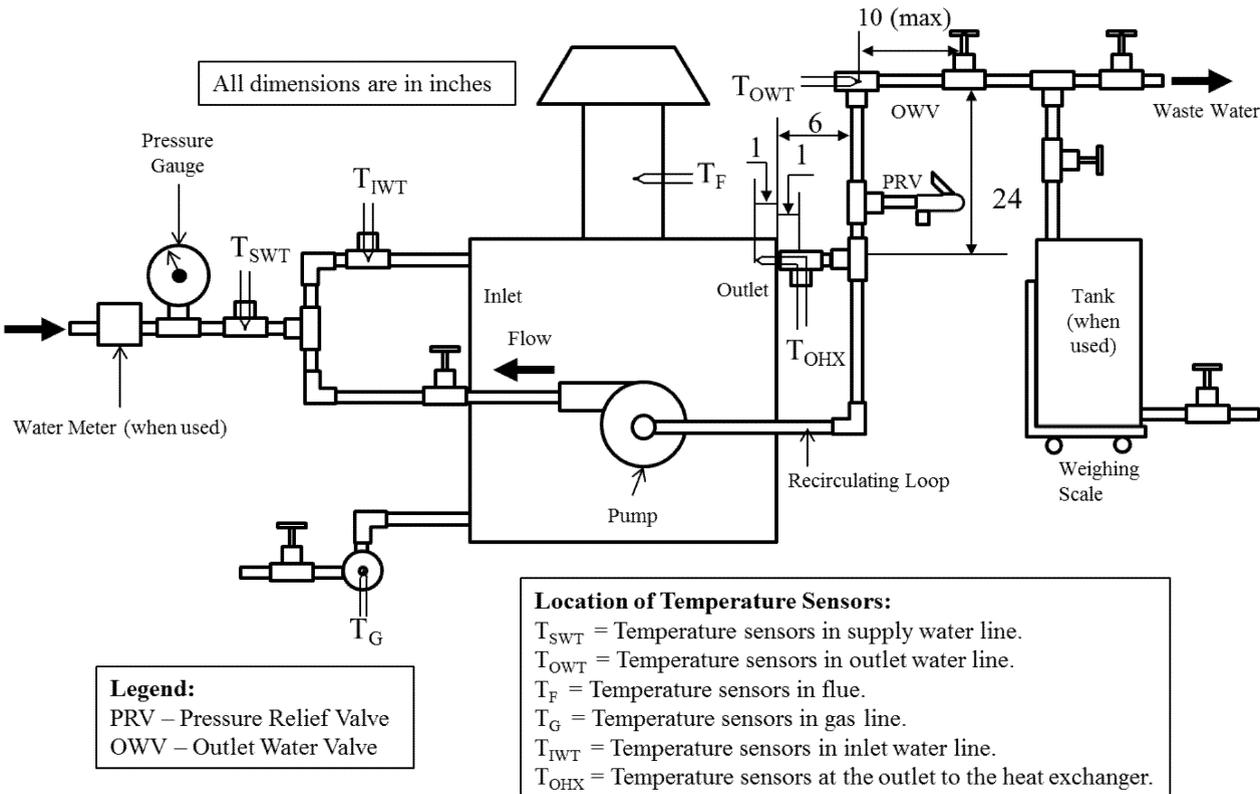


Figure 2.4. Set-up for standby loss test for electric instantaneous water heaters (other than storage-type instantaneous water heaters) requiring a recirculating loop for testing.